



Water Line and Fire Hydrant to New Apron Area


CIP Project Summary



Project No: 93122

Type: Airports

Supervisor District(s) 3

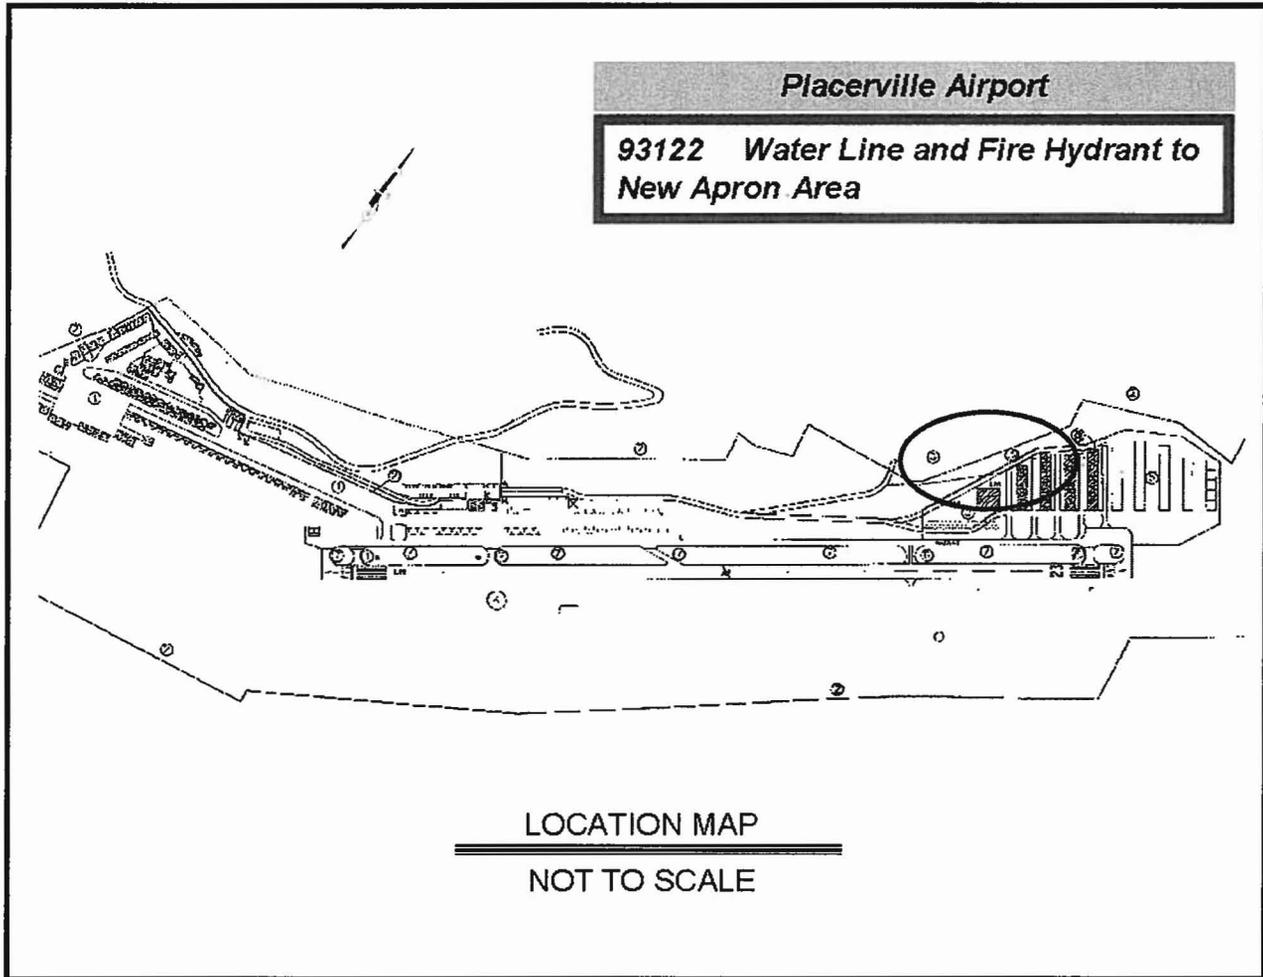

Project Description:

Placerville Airport - The Airport Layout Plan for this airport forecasts a need for additional hangars in the future (See Project No. 93128). Fire protection is required be able to develop the northeast ramp area of the airport to add new hangars. This project includes construction of a new 10-inch water line running 1200 feet from existing facilities plus three new fire hydrants. These fire hydrants will be located along the south end of the tee hangar development area. Provisions will be made to be able to add more hydrants along the edge of the aircraft parking apron in the future when they are needed.

Original Budget: \$165,000

Expenses to Date: \$0

Project Initiation Date: 05/05/09